









Size: DN 15 to DN 200 Ends: Flanges R.F. PN40

Min Temperature : - 20°C Max Temperature : + 400°C Max Pressure : 40 Bars

Specifications: Non rising stem

Bolted bonnet and gland pack

Stainless steel bellow

Materials: Carbon steel





SPECIFICATIONS:

Respect the flow direction indicated by the arrow Non rising stem
Bolted bonnet and gland pack
Stainless steel bellow
Conical disc
Pressed seat in the body
Anti-turn device to avoid the risk of torsion of bellows
Flanges R.F. PN40
RAL 5002 blue painting, 15µ thickness

USE:


Common fluids of 2^{nd} group , steam , thermic fluid Min and max Temperature Ts : - $20^{\circ}C$ to + $400^{\circ}C$ Max Pressure Ps : 40 bars (see graph under) Keep greased the stem

FLOW COEFFICIENT Kvs (M3/h):

DN	15	20	25	32	40	50	65	80	100	125	150	200
Kvs (m3/h)	3.8	7	10	19	35	43	60	110	146	210	300	670

PRESSURE / TEMPERATURE GRAPH:

Pressure (Bar)

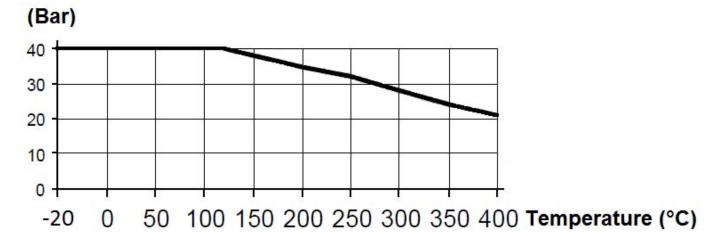

RANGE:


Carbon steel globe valve with stainless steel bellow flanged R.F. PN40 from DN 15 to DN 200 Ref. 475







MATERIALS:

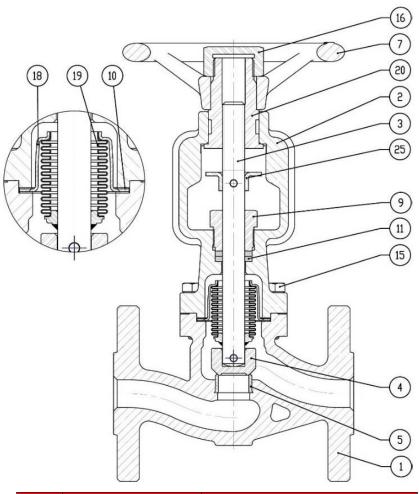


Item	Designation	Materials				
1	Body	ASTM A216 WCB				
2	Bonnet	ASTM A216 WCB				
3	Stem	AISI 303 (1.4305)				
4	Disc	AISI 420 (1.4021)				
5	Seat	X 22 CrNi 17 (1.4059)				
7	Handwheel	Ductile iron EN GJS-400				
9	Gland	Steel EN 10087				
10	Gasket	Graphite				
11	Packing	Graphite				
15	Screw	Steel C35E				
16	Handwheel nut	EN 10087				
18	Hood	AISI 303 (1.4305)				
19	Bellow	AISI 316 Ti (1.4571)				
20	Threaded bushing	Steel EN 10087				
25	Anti turn device	Steel EN 10025				
	Lubricator	Brass				





SIZE (in mm):

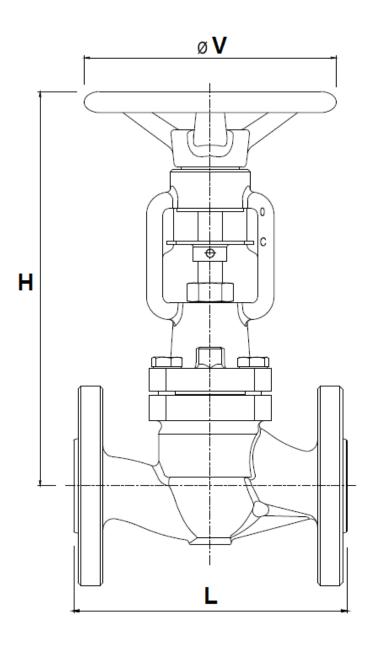


Ref.	DN	15	20	25	32	40	50	65	80	100	125	150	200
475	L	130	150	160	180	200	230	290	310	350	400	480	600
	Н	190	195	220	219	254	265	328	341	376	488	531	663
	øν	140	140	140	140	180	180	200	200	250	330	330	400
	Weight (Kg)	3.7	4.8	6.8	7.8	13	15.5	23	28	43	68	100	202





FLANGES SIZE (in mm):

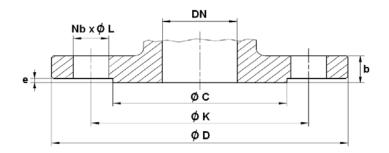

DN	15	20	25	32	40	50	65	80	100	125	150	200
øс	45	58	68	78	88	102	122	138	162	188	218	285
Ø D	95	105	115	140	150	165	185	200	235	270	300	375
øк	65	75	85	100	110	125	145	160	190	220	250	320
Nb x Ø L	4 x 14	4 x 14	4 x 14	4 x 18	4 x 18	4 x 18	8 x 18	8 x 18	8 x 22	8 x 26	8 x 26	12 x 30
b	16	18	18	18	18	20	22	24	24	26	28	34
е	2	2	2	2	3	3	3	3	3	3	3	3

STANDARDS:

Fabrication according to ISO 9001:2008

Designing according to DIN 3840

Marking according to EN 19

DIRECTIVE 97/23/CE: CE N° 0035

Risk Category III module H

Pressure Tests according to EN 12266-1, range A

Length according to EN 558 series 1 (DIN 3202 F1)

Flanges R.F. according to EN 1092-1 PN40

ADVICE: Our opinion and our advice are not guaranteed and SFERACO shall not be liable for the consequences of damages. The customer must check the right choice of the products with the real service conditions.





INSTALLATION INSTRUCTIONS

GENERAL GUIDELINES:

Ensure that the valves to be used are appropriate for the conditions of the installation (type of fluid, pressure and temperature).

Be sure to have enough valves to be able to isolate the sections of piping as well as the appropriate equipment for maintenance and repair.

Ensure that the valves to be installed are of correct strength to be able to support the capacity of their usage.

Installation of all circuits should ensure that their function can be automatically tested on a regular basis (at least two times a year).

INSTALLATION INSTRUCTIONS:

Before installing the valves, clean and remove any objects from the pipes (in particular bits of sealing and metal) which could obstruct and block the valves.

Ensure that both connecting pipes either side of the valve (upstream and downstream) are aligned (if they're not, the valves may not work correctly).

Make sure that the two sections of the pipe (upstream and downstream) match, the valve unit will not absorb any gaps. Any distortions in the pipes may affect the thightness of the connection, the working of the valve and can even cause a rupture. To be sure, place the kit in position to ensure the assembling will work.

If sections of piping do not have their final support in place, they should be temporarily fixed. This is to avoid unnecessary strain on the valve.

Tighten the bolts in cross.

It's recommended to operate the valve (open and close) 1 to 2 times per year

Tighten the gland packing at the first start of the installation (with a moderate torque) so that there's no leakage and the handwheel is easy to operate.

Do not use tools to operate the handwheel

Respect the flow direction indicated by the arrow



